


TYPE OF FALSE ALARM	NUMBER O
Malicious, Mischievous False Call	11
System Malfunction	180
Unintentional (tripping on interior device accidentally, etc.)	256
Other False Alarms (bomb scares, etc.)	71
TOTAL	518


Total (3025)

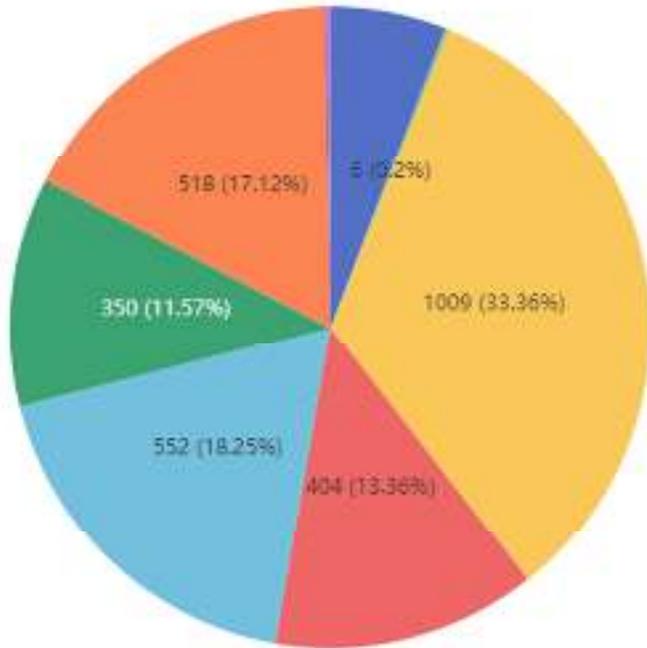

Incident Type Major

- 1 - Fire
- 2 - Overpressure Rupture, Explosion, Overheat(no fire)
- 3 - Rescue & Emergency Medical Service Incident
- 4 - Hazardous Condition (No Fire)
- 5 - Service Call
- 6 - Good Intent Call
- 7 - False Alarm & False Call
- 8 - Severe Weather & Natural Disaster
- 9 - Special Incident Type

Total (90)

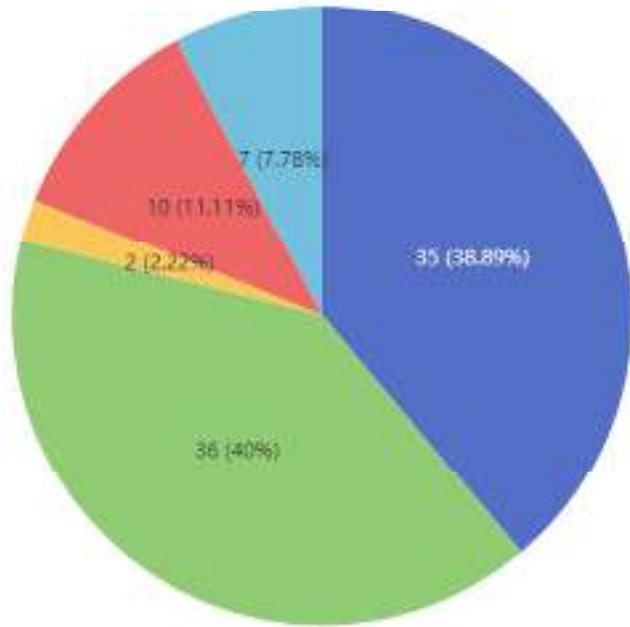

Incident Type Minor

- 111 - Building fire
- 113 - Cooking fire, confined to container
- 114 - Chimney or flue fire, confined to chimney or flue
- 116 - Fuel burner/boiler malfunction, fire confined
- 118 - Trash or rubbish fire, contained

HOUR	SUNDAY	MONDAY	TUESDAY	WEDNESDAY	THURSDAY	FRIDAY
0:00	13	6	6	7	9	5
1:00	9	4	7	6	5	10
2:00	7	1	2	4	2	2
3:00	3	8	2	4	4	6
4:00	7	3	3	1	3	4
5:00	5	6	6	5	1	5
6:00	2	13	11	9	7	12
7:00	9	19	11	18	21	17
8:00	11	25	21	28	31	20
9:00	26	33	29	22	19	22
10:00	22	14	24	25	13	39
11:00	27	34	28	18	26	35
12:00	31	24	12	22	21	34
13:00	21	17	23	22	21	33
14:00	25	32	43	24	23	38
15:00	21	33	28	33	22	33
16:00	19	42	36	36	45	37
17:00	28	36	29	36	26	39
18:00	25	19	23	18	30	28
19:00	21	20	19	32	20	18
20:00	13	17	21	18	24	23
21:00	12	12	23	21	11	16
22:00	13	9	13	9	10	16
23:00	6	9	3	7	11	13
Count of Incidents	376	436	423	425	405	505

SATURDAY	TOTAL
9	55
11	52
9	27
5	32
6	27
8	36
7	61
16	111
15	151
20	171
24	161
25	193
38	182
28	165
33	218
26	196
28	243
31	225
18	161
21	151
31	147
16	111
20	90
10	59
455	3025



### FDR-NFIRS-002: Incident Type Summary, 2023

INCIDENT TYPE	COUNT	PERCENT
100 Series - Fire	193	6.01%
200 Series - Overpressure Rupture, Explosion, Overheat (No Fire)	6	0.19%
300 Series - Rescue and Emergency Medical Services Incident	1,060	33.02%
400 Series - Hazardous Condition (No Fire)	419	13.05%
500 Series - Service Call	572	17.82%
600 Series - Good Intent Call	373	11.62%
700 Series - False Alarm and False Call	570	17.76%
800 Series - Severe Weather and Natural Disaster	5	0.16%
900 Series - Special Incident Type	4	0.12%
Other	8	0.25%
Total:	3,210	100%

Actual Incident Type Found	Incident Count	Percent
100 - Fire, other	13	0.40%
111 - Building fire	41	1.30%
113 - Cooking fire, confined to container	40	1.30%
114 - Chimney or flue fire, confined to chimney or flue	2	0.10%
116 - Fuel burner/boiler malfunction, fire confined	10	0.30%
118 - Trash or rubbish fire, contained	8	0.30%
130 - Mobile property (vehicle) fire, other	4	0.10%
131 - Passenger vehicle fire	16	0.50%
140 - Natural vegetation fire, other	9	0.30%
141 - Forest, woods or wildland fire	1	0.00%
142 - Brush or brush-and-grass mixture fire	24	0.80%
143 - Grass fire	2	0.10%
150 - Outside rubbish fire, other	7	0.20%
151 - Outside rubbish, trash or waste fire	3	0.10%
154 - Dumpster or other outside trash receptacle fire	4	0.10%
155 - Outside stationary compactor/compacted trash fire	1	0.00%
160 - Special outside fire, other	4	0.10%
161 - Outside storage fire	1	0.00%
162 - Outside equipment fire	1	0.00%
170 - Cultivated vegetation, crop fire, other	1	0.00%
212 - Overpressure rupture of steam boiler	2	0.10%
240 - Explosion (no fire), other	1	0.00%
243 - Fireworks explosion (no fire)	3	0.10%
300 - Rescue, EMS incident, other	6	0.20%
311 - Medical assist, assist EMS crew	108	3.40%
320 - Emergency medical service incident, other	2	0.10%
321 - EMS call, excluding vehicle accident with injury	7	0.20%
322 - Motor vehicle accident with injuries	244	7.60%
323 - Motor vehicle/pedestrian accident (MV Ped)	15	0.50%
324 - Motor vehicle accident with no injuries.	630	19.70%
331 - Lock-in (if lock out , use 511 )	10	0.30%
340 - Search for lost person, other	1	0.00%
350 - Extrication, rescue, other	6	0.20%
351 - Extrication of victim(s) from building/structure	3	0.10%
352 - Extrication of victim(s) from vehicle	11	0.30%
353 - Removal of victim(s) from stalled elevator	11	0.30%
355 - Confined space rescue	1	0.00%
356 - High-angle rescue	1	0.00%
363 - Swift water rescue	3	0.10%
400 - Hazardous condition, other	9	0.30%
410 - Combustible/flammable gas/liquid condition, other	6	0.20%
411 - Gasoline or other flammable liquid spill	16	0.50%
412 - Gas leak (natural gas or LPG)	47	1.50%
413 - Oil or other combustible liquid spill	20	0.60%
421 - Chemical hazard (no spill or leak)	1	0.00%
422 - Chemical spill or leak	2	0.10%

423 - Refrigeration leak	1	0.00%
424 - Carbon monoxide incident	35	1.10%
440 - Electrical wiring/equipment problem, other	63	2.00%
441 - Heat from short circuit (wiring), defective/worn	2	0.10%
442 - Overheated motor	10	0.30%
444 - Power line down	109	3.40%
445 - Arcing, shorted electrical equipment	17	0.50%
451 - Biological hazard, confirmed or suspected	2	0.10%
460 - Accident, potential accident, other	2	0.10%
461 - Building or structure weakened or collapsed	3	0.10%
463 - Vehicle accident, general cleanup	73	2.30%
500 - Service Call, other	19	0.60%
510 - Person in distress, other	8	0.30%
511 - Lock-out	226	7.10%
512 - Ring or jewelry removal	1	0.00%
520 - Water problem, other	56	1.80%
521 - Water evacuation	35	1.10%
522 - Water or steam leak	31	1.00%
531 - Smoke or odor removal	30	0.90%
540 - Animal problem, other	1	0.00%
550 - Public service assistance, other	22	0.70%
551 - Assist police or other governmental agency	50	1.60%
552 - Police matter	1	0.00%
553 - Public service	3	0.10%
555 - Defective elevator, no occupants	3	0.10%
561 - Unauthorized burning	85	2.70%
571 - Cover assignment, standby, moveup	1	0.00%
600 - Good intent call, other	98	3.10%
611 - Dispatched & canceled en route	164	5.10%
621 - Wrong location	1	0.00%
622 - No incident found on arrival at dispatch address	56	1.80%
650 - Steam, other gas mistaken for smoke, other	3	0.10%
651 - Smoke scare, odor of smoke	33	1.00%
652 - Steam, vapor, fog or dust thought to be smoke	3	0.10%
653 - Smoke from barbecue, tar kettle	2	0.10%
671 - HazMat release investigation w/no HazMat	13	0.40%
700 - False alarm or false call, other	76	2.40%
710 - Malicious, mischievous false call, other	3	0.10%
711 - Municipal alarm system, malicious false alarm	3	0.10%
714 - Central station, malicious false alarm	6	0.20%
730 - System malfunction, other	19	0.60%
731 - Sprinkler activation due to malfunction	9	0.30%
732 - Extinguishing system activation due to malfunction	2	0.10%
733 - Smoke detector activation due to malfunction	71	2.20%
734 - Heat detector activation due to malfunction	5	0.20%
735 - Alarm system sounded due to malfunction	61	1.90%
736 - CO detector activation due to malfunction	34	1.10%

740 - Unintentional transmission of alarm, other	45	1.40%
741 - Sprinkler activation, no fire - unintentional	6	0.20%
743 - Smoke detector activation, no fire - unintentional	101	3.20%
744 - Detector activation, no fire - unintentional	15	0.50%
745 - Alarm system activation, no fire - unintentional	99	3.10%
746 - Carbon monoxide detector activation, no CO	14	0.40%
800 - Severe weather or natural disaster, other	2	0.10%
812 - Flood assessment	3	0.10%
911 - Citizen complaint	4	0.10%
Total Incidents:	3198	100.00%